



Pimpri Chinchwad Municipal Corporation
Pimpri, Pune - 411018.
Phone :- 020- 67331110/1120
Fax :- 020- 27425600
E-Mail :- commissioner@pcmcindia.gov.in
Web :- www.pcmcindia.gov.in

No - ws / lab / 1990 / 2023

Date - 04 / 07 / 2023

To,


Galaxy School,

Dighi.

Subject : Water sample Potability Certificate.

Drinking water sample provided by Galaxy School Dighi on Date: 30/06/2023 was analysed for Bacteriological & Chemical analysis. As per the analysis reports no.ws/lab/1989/2023 dated 04/07/2023 and no.ws/lab/1981/2023 dated 02/07/2023 the water sample is safe for drinking purpose. The Bacteriological analysis reports attached herewith.

Note-The water sample not drawn by this laboratory.


CHIEF CHEMIST

Pimpri Chinchwad Municipal Corporation
Pimpri -18


Principal
Galaxy School
S. No. 78, Bhosari-Alandi Road,
Dighi-15.


School Manager
Galaxy School
Sr.No. 78, Bhosari-Alandi Road,
Dighi, Pune - 411015.

PIMPRI CHINCHWAD MUNICIPAL CORPORATION

(W/S) DIVISION



Report Of Chemical Examination Of Water

NO-WS / LAB / 1989 / 2023

DATE - 04 / 07 / 2023

DATE OF RECEIPT - 30 / 06 / 2023

DATE OF EXAMINATION - 3 / 07 / 2023


NAME - Galaxy School


ADDRESS - Dighi


SOURCE Filter water

NO	TESTS	I.S Standards for Drinking Water	Result mg/lit	Result mg/lit	Conclusion
1	Turbidity	1 N.T.U Max	0.64 NTU	/	
2	pH	6.5 to 8.5	6.48		
3	Total Hardness (as CaCO ₃)	200 mg/lit	44 mg/lit		
4	Chloride	250 mg/lit	12 mg/lit		
5	Calcium	75 mg/lit	4.80 mg/lit		

NOTE - SAMPLE NOT DRAWN BY THIS LABORATORY


Principal
Galaxy School
S. No. 78, Bhosari-Alandi Road,
Dighi-15.


School Manager
Galaxy School
Sr.No. 78, Bhosari-Alandi Road,
Dighi, Pune - 411015.


CHIEF CHEMIST
Water treatment plant
sector 23 Nigdi

PIMPRI CHINCHWAD MUNICIPAL CORPORATION

(w/s) DIVISION

No-WS/LAB/198/2023

Date-02/07/2023

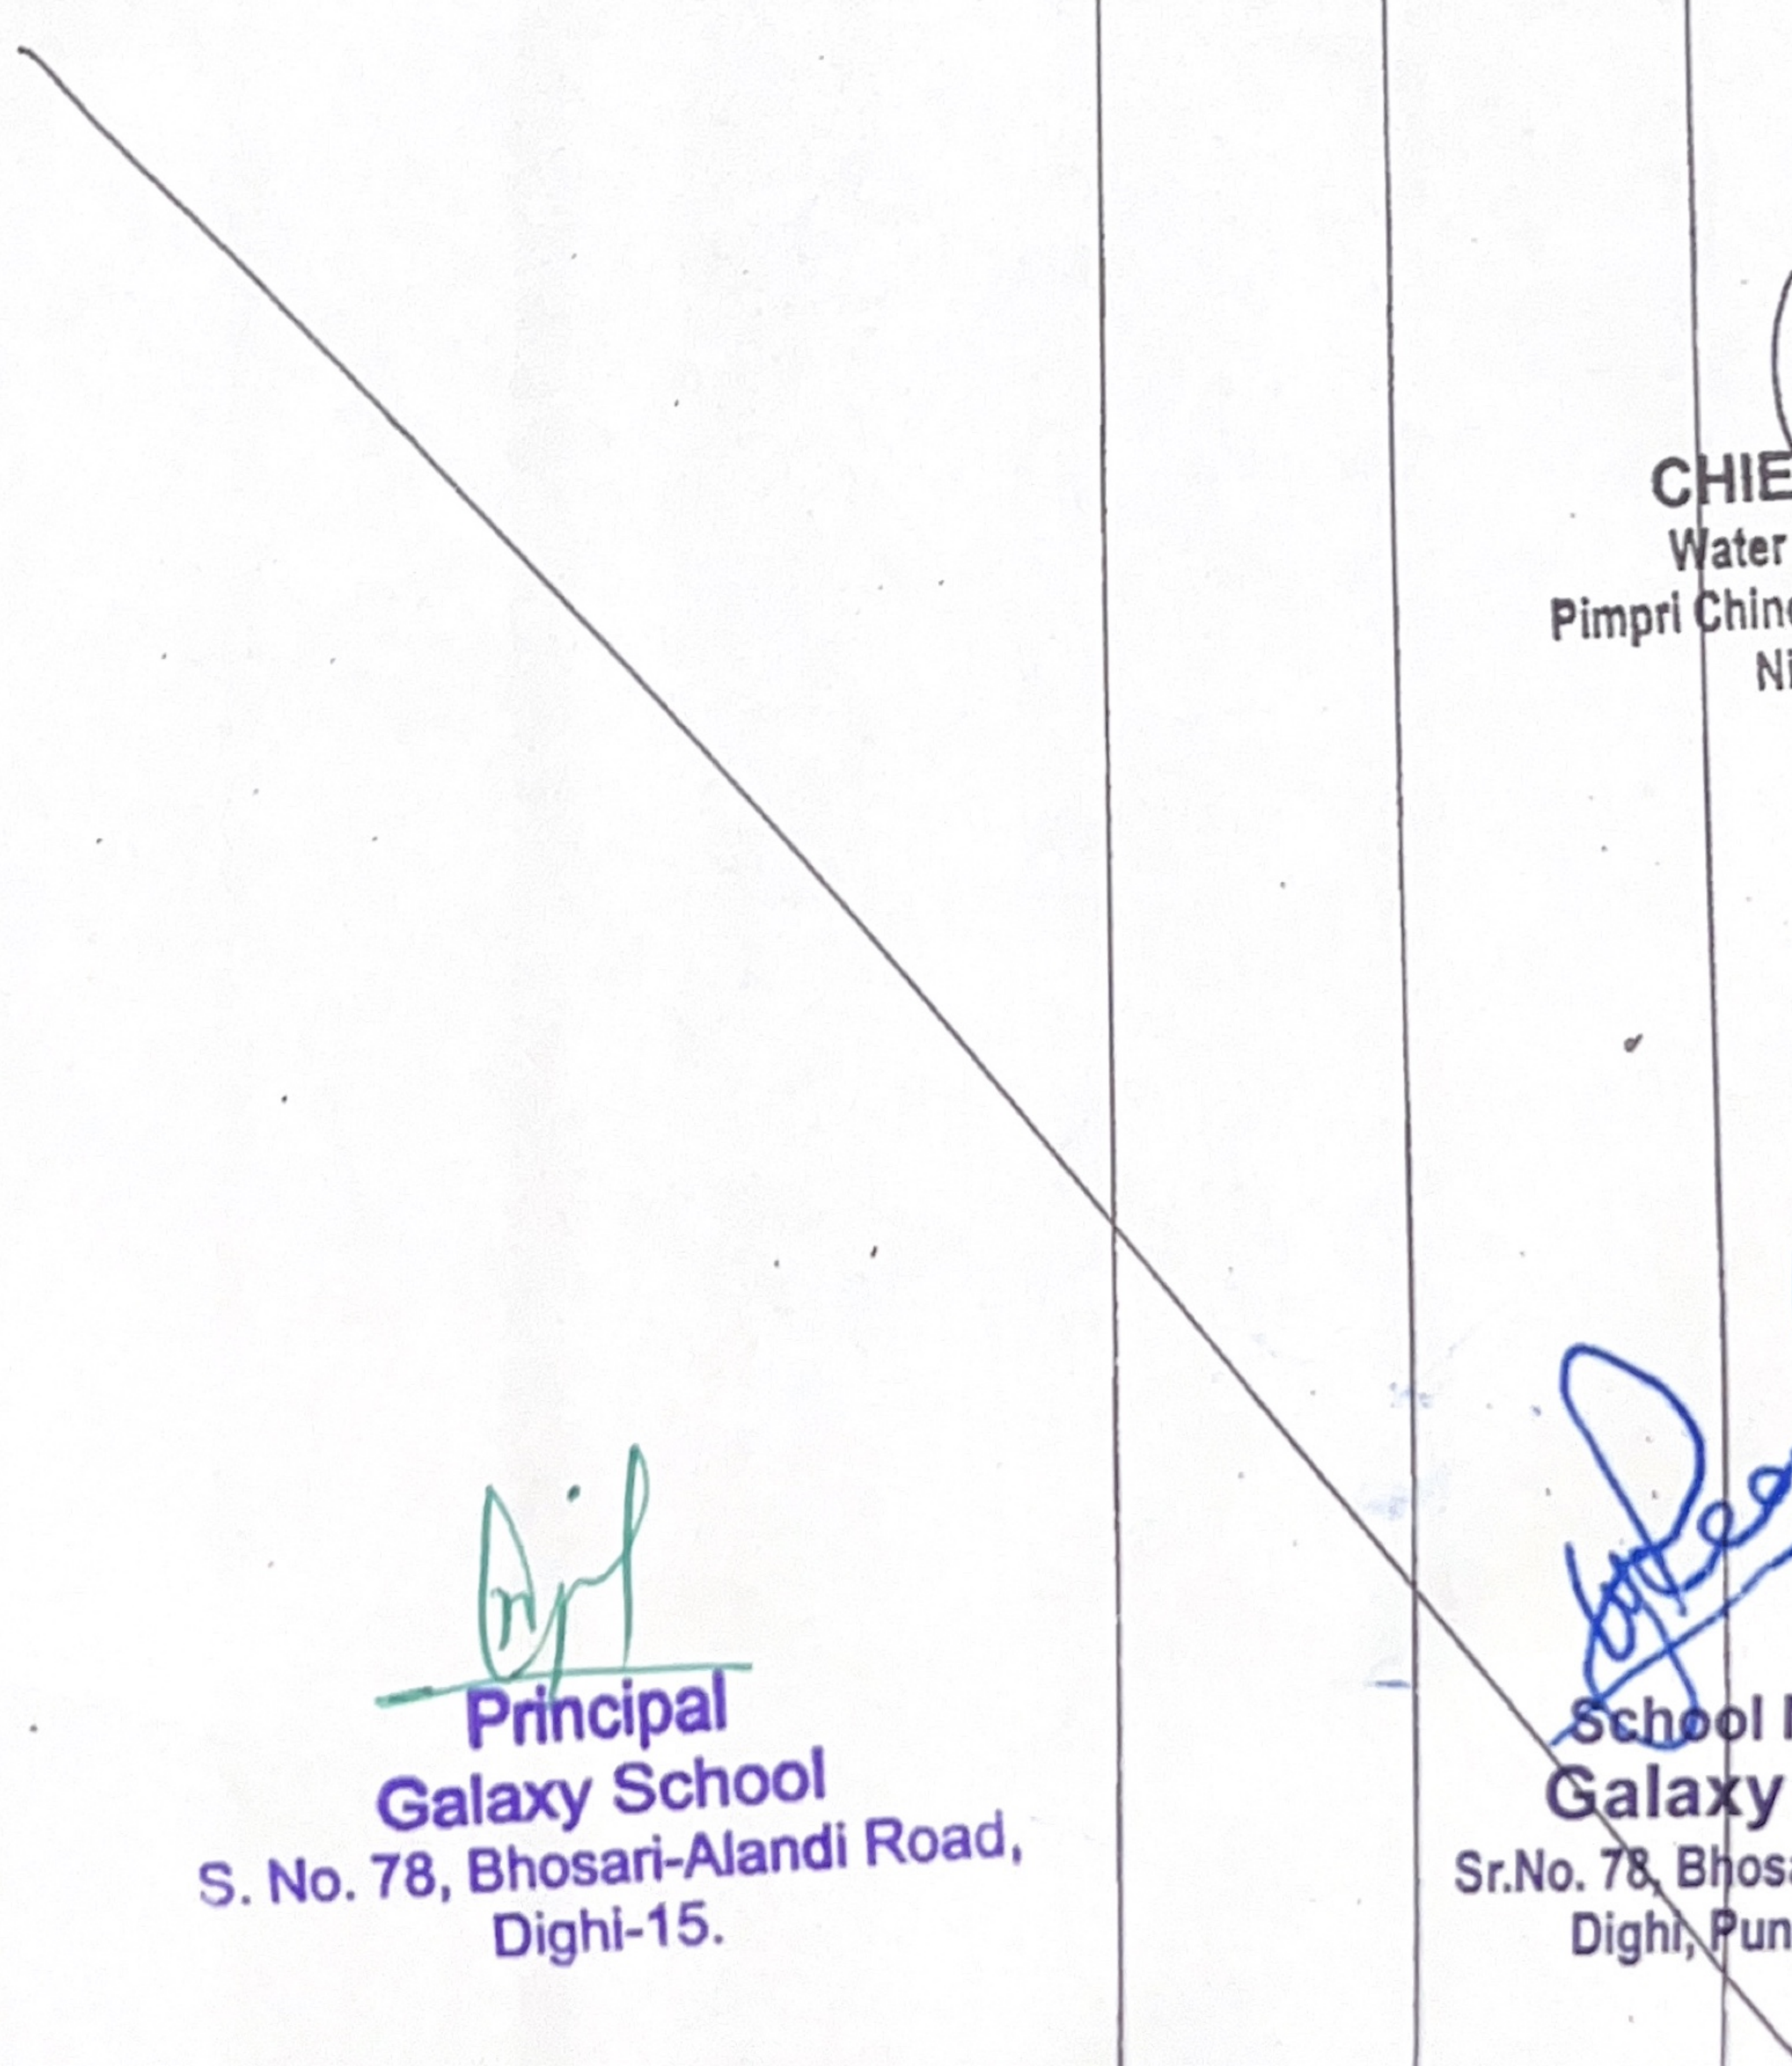
REPORT OF BACTERIOLOGICAL EXAMINATION OF WATER


NAME- Galaxy School


DATE OF EXAMINATION 30/06/2023

ADDRESS- Dighi

SOURCE- Filter water

NO.	WATER SAMPLE (PLACE)	RESIDUAL CHLORINE (PPM)	CONCLUSION MPN/100ml		REMARK	
			Coliforms	E.Coll		
1	water sample	nil	0/100ml	-	potable	
2						
3						
4						
5						
6						
7						
8						
9						
10						
11						
12						


CHIEF CHEMIST
 Water Treatment Plant
 Pimpri Chinchwad Municipal Corp.
 Nigdi, Pune 44


Principal
Galaxy School
 S. No. 78, Bhosari-Alandi Road,
 Dighi-15.


School Manager
Galaxy School
 Sr.No. 78, Bhosari-Alandi Road,
 Dighi, Pune - 411015.